Kathy Catazaro-Perry, Mayor
Massillon
City of Champions

CITY OF MASSILLON BUILDING DEPARTMENT
MUNICIPAL GOVERNMENT CENTER
ONE JAMES DUNCAN PLAZA, MASSILLON, OH 44646
PHONE: (330) 830-1724 * FAX: (330) 830-1782

RESIDENTIAL DECK INFORMATION & INSTRUCTIONS

3 INSPECTION REQUIRED

- Post Holes
- Framing
- Final

PLANS REQUIRED

- Fill out attached sheets 1 through 4
- Provide any additional plan you have

SHEET 1 - BUILDING PERMIT APPLICATION

- Fill out hi-lighted areas

SHEET 2 - PLOT SITE PLAN

- Show property lines
- Show set backs
- Show residential house, garage, all out building in proper locations and all dimension to property lines

SHEET 3 - POST HOLE FOOTER PLAN

- Show all post hole locations and dimensions

Footer Plan Items that must be shown:

Footers for decks not exceeding 72" in height

1. Show all post hole locations and dimensions
2. Hole diameter to be 12" throughout
3. Minimum depth of hole must be 36"
4. 8" of concrete placed in bottom of hole
5. Backfill around 4x4 posts with either compacted earth or poured concrete

Footers for decks exceeding 72" in height

1. Show all post hole locations and dimension
2. Hole diameter to be 18" throughout
3. Minimum depth of hole must be 42"
4. 8" of concrete placed in bottom of hole. 6x6 post MUST be set in concrete

SHEET 4 - FRAMING PLAN

Items that must be shown:

1. Ledger board not allowed to be attached to brick veneer or hollow masonry walls
2. Call before floor boards are installed

SPAN TABLES

RCO TABLE 502.3.1(2)
JOIST SPAN TABLE

JOIST SPACING	MAX CLEAR SPAN
2X6 @ 16" ON CENTER	9'-9"
2X6 @ 24" ON CENTER	8'-6"
2X8 @ 16" ON CENTER	12'-10"
2X8 @ 24" ON CENTER	11'
2X10 @ 16" ON CENTER	16'1"
2X10 @ 24" ON CENTER	13'1"
2X12 @ 16" ON CENTER	18'10"
2X12 @ 24" ON CENTER	15'5"

RCO TABLE 502 5.1
BEAM GIRDER SPAN

BEAM – GIRDERS	MAY CLEAR SPAN
(2) 2"x6"	5'5"
(2) 2"x8"	6'x10"
(3) 2"x8"	8'4"
(4) 2"x8"	9'2"
(2) 2"x10"	8'5"
(3) 2"x10"	10'6"
(4) 2"x10"	11'8"
(2) 2"x12"	9'9"
(3) 2"x12"	10'6"
(4) 2"x12"	11'8"

Residential Deck

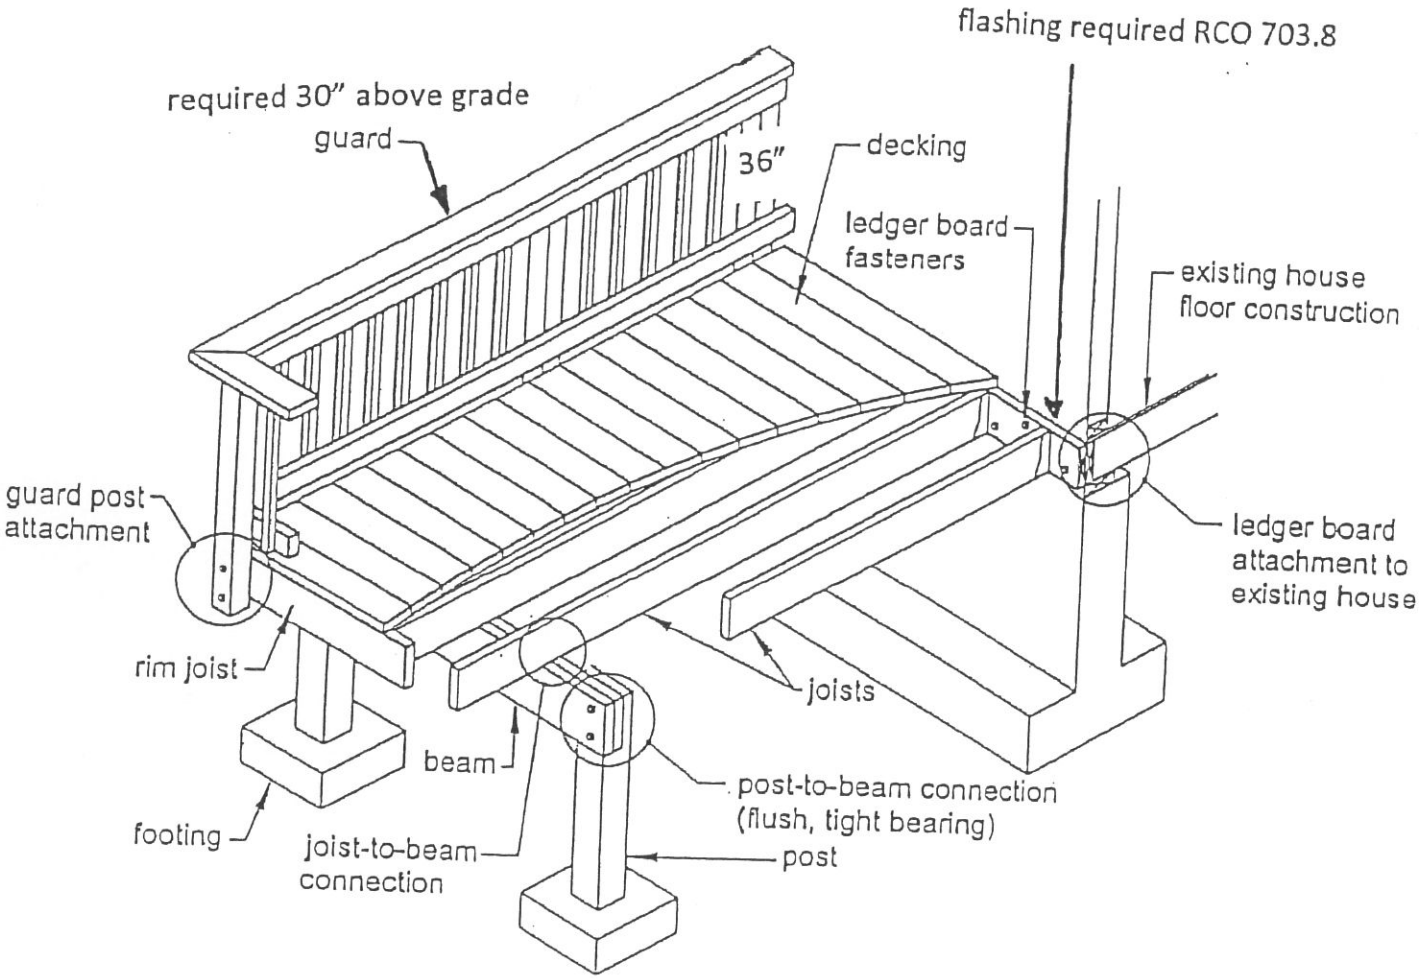

SHEET 1

CITY OF MASSILLON, OHIO
Department of Public Safety—Building Division

FEE $ _____

Application for Building Permit

Date _____

TO THE INSPECTOR OF BUILDINGS:

Application is hereby made for PERMIT to erect a structure as herein described:

The acceptance of which shall constitute an agreement on Owner's part to abide by all conditions herein contained, and to comply with all Ordinances of the City of Massillon and the laws of the State of Ohio relating to the work to be done hereunder:

Owner _____ Address _____ Phone _____

Elec. Contr. _____ Address _____ Phone _____

Plumb. Contr. _____ Address _____ Phone _____

Heating Contr. _____ Address _____ Phone _____

Gen. Contr. _____ Address _____ Phone _____

LOCATION AND DESCRIPTION OF BUILDING AND PROPERTY

Street and No. _____

_____ Side of Street. Sublot No. _____ Allotment _____

Lot being } _____ ft. front _____ ft. deep on the _____ side
_____ ft. rear _____ ft. deep on the _____ side

Were Drawings Approved? _____

Number of stories _____ and basement _____ Estimated Cost Complete $ _____

Size of Building: Width _____ Depth _____ Total Height _____

Type of Construction: ☐ FRAME ☐ COMPOSITE ☐ MILL ☐ SLOW BURNING ☐ FIRE PROOF

Sq. ft. of contents _____ How is building to be occupied? _____ CLASS OF BUILDING _____

Is Street Curb in to establish grade in front of building? _____ Bldg. grade necessary _____

Footer _____
Foundation _____
Rough(s) _____
Additional _____
Penalty _____
Other _____
Base _____
$0-$100,000, $.50\100 _____
Over $100,000 $1.00\1000 _____
Subtotal _____
1 or 3% BBS _____
Total _____

Remarks _____

Signature of Applicant _____

The applicant, agent, owner of this building and the undersigned... (1) Agrees to conform to applicable laws of the City of Massillon and State of Ohio. (2) Responsible to verify that the job location is with-in the city limits. (3) No refund will be issued. (4) The address is correct. (5) Responsible for making arrangements for all inspections. (6) General contractor shall notify all utility companies involved in the site no more than ten days and no less than 48 hours in advance of excavation. (ORC 3781.28)

Building Permit

YOU ARE HEREBY GRANTED PERMISSION to: ☐ Repair ☐ Raze ☐ Remodel ☐ Erect

a structure at _____

in the City of Massillon, Ohio, in accordance with your application on file in this Department, said structure to be completed by _____. Until that time you have permission to occupy one-third of the street in front of said lots. If the sidewalk is obstructed, a temporary sidewalk, four feet in width at least, as high as the curb line, must be constructed around the obstruction and the side towards the street to be tightly boarded up to 3 feet in height above the walk, but at all times, you are to comply with all ordinances of the City of Massillon and the laws of State of Ohio relative to the construction and erecting of buildings.

AND IN ADDITION THERETO, the recipient of this permit shall indemnify and save harmless the City of Massillon or any private individual or corporation that may be damaged through erection of the structure.

_____, Building Official

_____

SHEET 2

PLOT PLAN

SHOW DECK LOCATION

SHOW ALL DEMINSION TO PROPERTY LINES

PROPERTY LINES

HOUSE

FRONT OF HOUSE

STREET NAME

SHEET 3

POST HOLE LOCATIONS

This is your first inspection.

Provide all post hole locations and dimensions.

Provide post to post and overall dimensions.

All post hole are excavated with all loose debris and water cleaned out before concrete for inspection.

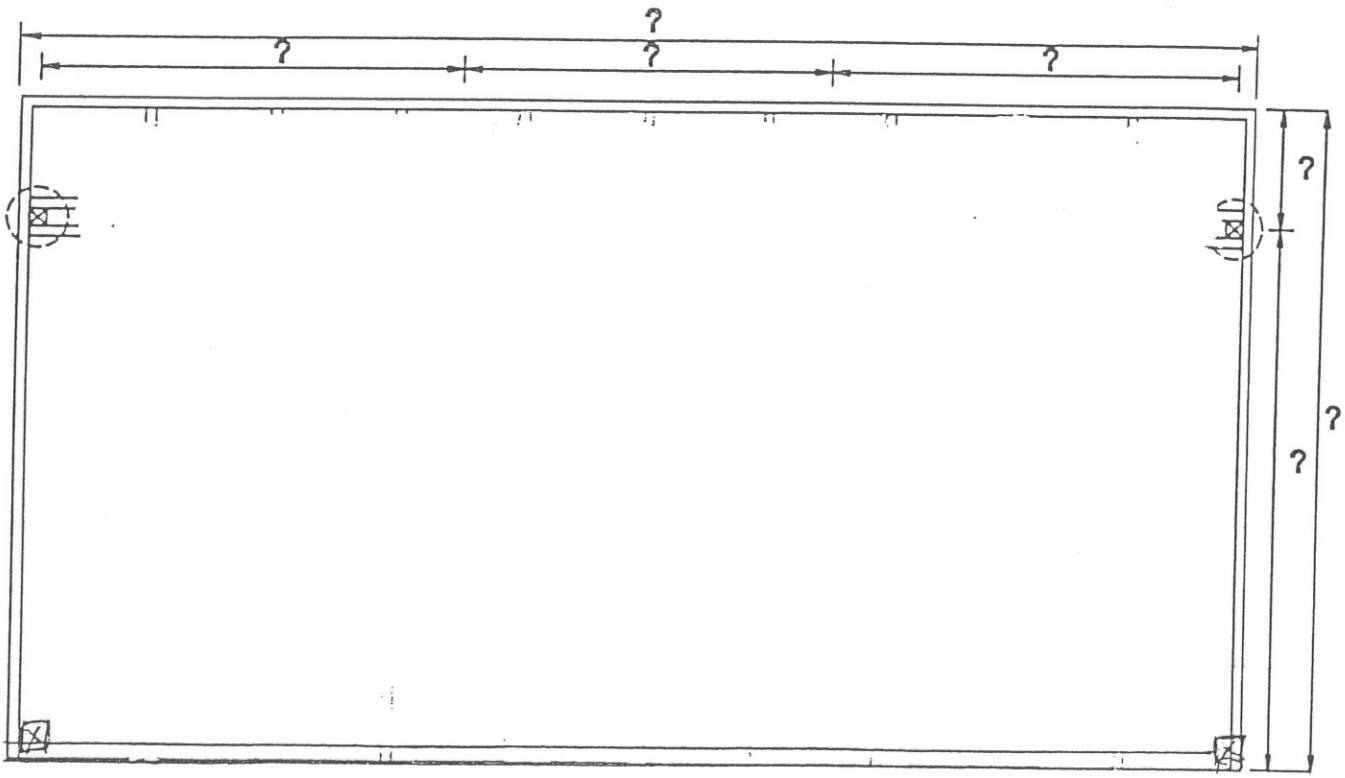

SHEET 4

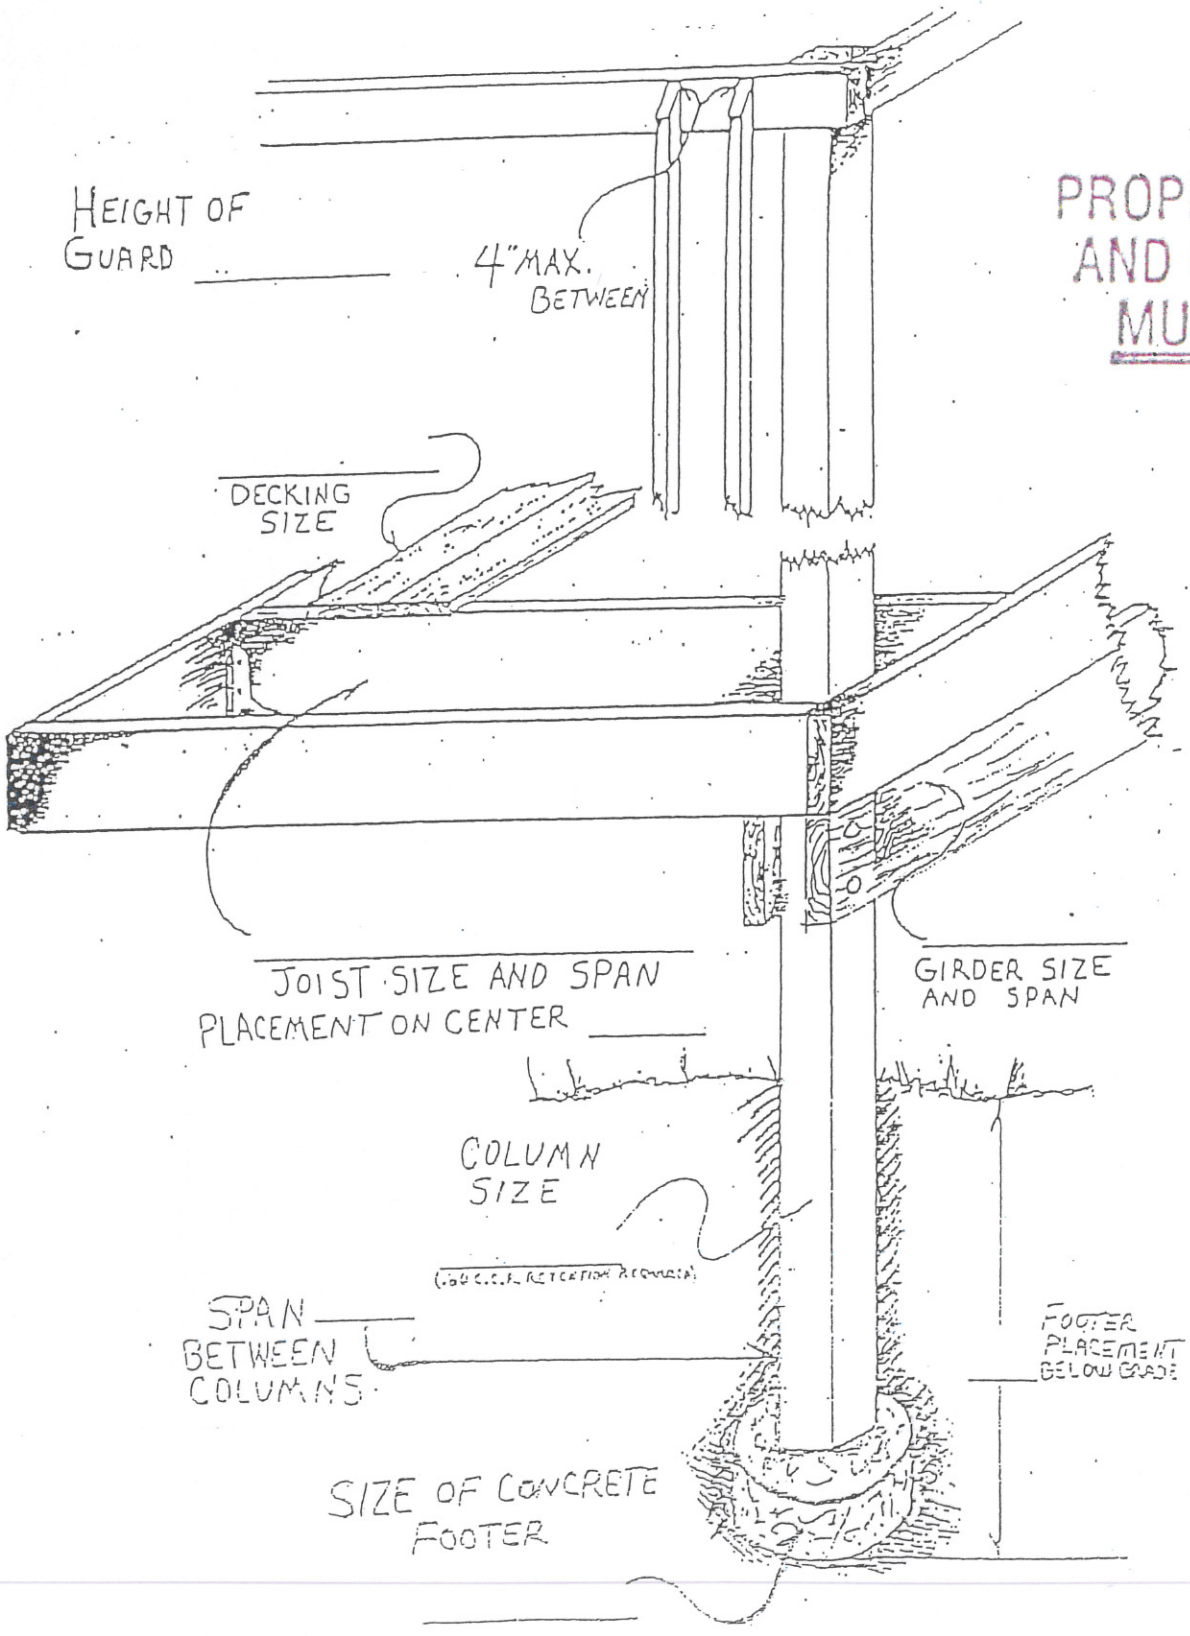

PROPER FASTENERS AND CONNECTORS MUST BE USED

DECK X-SECTION

GENERAL DECK REQUIREMENTS
CITY OF MASSILLON, OHIO

FLOOR JOISTS:
40 LBS /SQ FT LIVE LOAD; MODULUS OF ELASTICITY, "E" in 1,000,000 PSI = 1.1; DESIGN VALUE IN BENDING "B"
2x6=1310 2x8=1210 2x10=1105 2x12=1005
NO 2x4 JOISTS ALLOWED

LEDGER BOLT SIZE AND SPACING

-MINIMUM 8" LEDGER

-BOLT 2" FROM EDGE

Table RCO 502.2.2.1

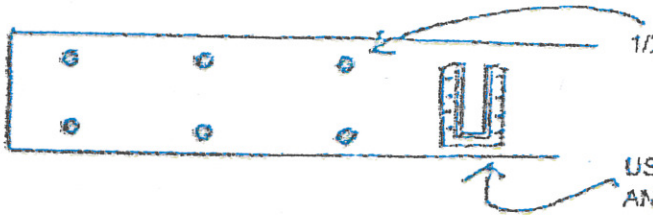

1/2" PAIRS OF LAG BOLTS 16" OR 24" O.C.
(DEPENDING ON JOIST SPAN)
SPANS OVER 10' - 16" O.C

USE CORRECTLY SIZED AND APPROVED JOIST HANGERS AND FILL EVERY HOLE WITH APPROVED JOIST HANGER NAILS

DIG 10' DIAMETER HOLES TO A MINIMUM DEPTH OF 36" BELOW GRADE
POUR A MINIMUM OF 8" CONCRETE INTO HOLES (MAY USE MORE)
THEN CALL FOR A FOOTING INSPECTION BEFORE CONCRETE

PROPER FASTENERS AND CONNECTORS MUST BE USED

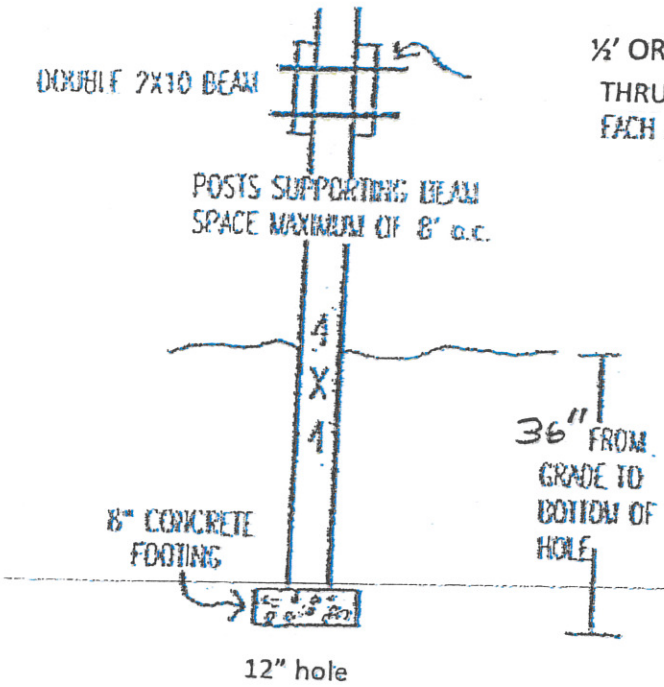

GUARDRAIL: DECKS 30" OR MORE ABOVE GRADE OR OPEN SIDES OF STAIRS 30" ABOVE GRADE

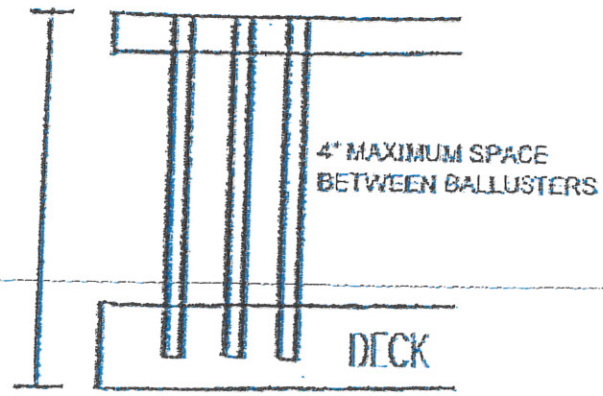

36" MINIMUM HEIGHT (34" FOR STAIR RAILS)

4 STEPS REQUIRE HAND RAILS

INSPECTIONS

1) CALL FOR HOLE INSPECTION BEFORE CONCRETE
2) CALL FOR FRAMING INSPECTION BEFORE DECKING
3) CALL FOR FINAL INSPECTION WHEN COMPLETE

TABLE 502.3.1(2)
FLOOR JOIST SPANS FOR COMMON LUMBER SPECIES
(Residential living areas, live load = 40 psf, L/Δ = 360)[b]

JOIST SPACING (inches)	SPECIES AND *GRADE*		DEAD LOAD = 10 psf				DEAD LOAD = 20 psf			
			2×6	2×8	2×10	2×12	2×6	2×8	2×10	2×12
			Maximum floor joist spans							
			(ft - in.)	(ft - in.)	(ft - in.)	(ft - in.)	(ft - in.)	(ft - in.)	(ft - in.)	(ft - in.)
12	Douglas fir-larch	SS	11-4	15-0	19-1	23-3	11-4	15-0	19-1	23-3
	Douglas fir-larch	#1	10-11	14-5	18-5	22-0	10-11	14-2	17-4	20-1
	Douglas fir-larch	#2	10-9	14-2	17-9	20-7	10-6	13-3	16-3	18-10
	Douglas fir-larch	#3	8-8	11-0	13-5	15-7	7-11	10-0	12-3	14-3
	Hem-fir	SS	10-9	14-2	18-0	21-11	10-9	14-2	18-0	21-11
	Hem-fir	#1	10-6	13-10	17-8	21-6	10-6	13-10	16-11	19-7
	Hem-fir	#2	10-0	13-2	16-10	20-4	10-0	13-1	16-0	18-6
	Hem-fir	#3	8-8	11-0	13-5	15-7	7-11	10-0	12-3	14-3
	Southern pine	SS	11-2	14-8	18-9	22-10	11-2	14-8	18-9	22-10
	Southern pine	#1	10-11	14-5	18-5	22-5	10-11	14-5	18-5	22-5
	Southern pine	#2	10-9	14-2	18-0	21-9	10-9	14-2	16-11	19-10
	Southern pine	#3	9-4	11-11	14-0	16-8	8-6	10-10	12-10	15-3
	Spruce-pine-fir	SS	10-6	13-10	17-8	21-6	10-6	13-10	17-8	21-6
	Spruce-pine-fir	#1	10-3	13-6	17-3	20-7	10-3	13-3	16-3	18-10
	Spruce-pine-fir	#2	10-3	13-6	17-3	20-7	10-3	13-3	16-3	18-10
	Spruce-pine-fir	#3	8-8	11-0	13-5	15-7	7-11	10-0	12-3	14-3
16	Douglas fir-larch	SS	10-4	13-7	17-4	21-1	10-4	13-7	17-4	21-0
	Douglas fir-larch	#1	9-11	13-1	16-5	19-1	9-8	12-4	15-0	17-5
	Douglas fir-larch	#2	9-9	12-7	15-5	17-10	9-1	11-6	14-1	16-3
	Douglas fir-larch	#3	7-6	9-6	11-8	13-6	6-10	8-8	10-7	12-4
	Hem-fir	SS	9-9	12-10	16-5	19-11	9-9	12-10	16-5	19-11
	Hem-fir	#1	9-6	12-7	16-0	18-7	9-6	12-0	14-8	17-0
	Hem-fir	#2	9-1	12-0	15-2	17-7	8-11	11-4	13-10	16-1
	Hem-fir	#3	7-6	9-6	11-8	13-6	6-10	8-8	10-7	12-4
	Southern pine	SS	10-2	13-4	17-0	20-9	10-2	13-4	17-0	20-9
	Southern pine	#1	9-11	13-1	16-9	20-4	9-11	13-1	16-4	19-6
	Southern pine	#2	9-9	12-10	16-1	18-10	9-6	12-4	14-8	17-2
	Southern pine	#3	8-1	10-3	12-2	14-6	7-4	9-5	11-1	13-2
	Spruce-pine-fir	SS	9-6	12-7	16-0	19-6	9-6	12-7	16-0	19-6
	Spruce-pine-fir	#1	9-4	12-3	15-5	17-10	9-1	11-6	14-1	16-3
	Spruce-pine-fir	#2	9-4	12-3	15-5	17-10	9-1	11-6	14-1	16-3
	Spruce-pine-fir	#3	7-6	9-6	11-8	13-6	6-10	8-8	10-7	12-4
19.2	Douglas fir-larch	SS	9-8	12-10	16-4	19-10	9-8	12-10	16-4	19-2
	Douglas fir-larch	#1	9-4	12-4	15-0	17-5	8-10	11-3	13-8	15-11
	Douglas fir-larch	#2	9-1	11-6	14-1	16-3	8-3	10-6	12-10	14-10
	Douglas fir-larch	#3	6-10	8-8	10-7	12-4	6-3	7-11	9-8	11-3
	Hem-fir	SS	9-2	12-1	15-5	18-9	9-2	12-1	15-5	18-9
	Hem-fir	#1	9-0	11-10	14-8	17-0	8-8	10-11	13-4	15-6
	Hem-fir	#2	8-7	11-3	13-10	16-1	8-2	10-4	12-8	14-8
	Hem-fir	#3	6-10	8-8	10-7	12-4	6-3	7-11	9-8	11-3
	Southern pine	SS	9-6	12-7	16-0	19-6	9-6	12-7	16-0	19-6
	Southern pine	#1	9-4	12-4	15-9	19-2	9-4	12-4	14-11	17-9
	Southern pine	#2	9-2	12-1	14-8	17-2	8-8	11-3	13-5	15-8
	Southern pine	#3	7-4	9-5	11-1	13-2	6-9	8-7	10-1	12-1
	Spruce-pine-fir	SS	9-0	11-10	15-1	18-4	9-0	11-10	15-1	17-9
	Spruce-pine-fir	#	8-9	11-6	14-1	16-3	8-3	10-6	12-10	14-10
	Spruce-pine-fir	#2	8-9	11-6	14-1	16-3	8-3	10-6	12-10	14-10
	Spruce-pine-fir	#3	6-10	8-8	10-7	12-4	6-3	7-11	9-8	11-3
24	Douglas fir-larch	SS	9-0	11-11	15-2	18-5	9-0	11-11	14-9	17-1
	Douglas fir-larch	#1	8-8	11-0	13-5	15-7	7-11	10-0	12-3	14-3
	Douglas fir-larch	#2	8-1	10-3	12-7	14-7	7-5	9-5	11-6	13-4
	Douglas fir-larch	#3	6-2	7-9	9-6	11-0	5-7	7-1	8-8	10-1
	Hem-fir	SS	8-6	11-3	14-4	17-5	8-6	11-3	14-4	16-10[a]
	Hem-fir	#1	8-4	10-9	13-1	15-2	7-9	9-9	11-11	13-10
	Hem-fir	#2	7-11	10-2	12-5	14-4	7-4	9-3	11-4	13-1
	Hem-fir	#3	6-2	7-9	9-6	11-0	5-7	7-1	8-8	10-1
	Southern pine	SS	8-10	11-8	14-11	18-1	8-10	11-8	14-11	18-1
	Southern pine	#1	8-8	11-5	14-7	17-5	8-8	11-3	13-4	15-11
	Southern pine	#2	8-6	11-0	13-1	15-5	7-9	10-0	12-0	14-0
	Southern pine	#3	6-7	8-5	9-11	11-10	6-0	7-8	9-1	10-9
	Spruce-pine-fir	SS	8-4	11-0	14-0	17-0	8-4	11-0	13-8	15-11
	Spruce-pine-fir	#1	8-1	10-3	12-7	14-7	7-5	9-5	11-6	13-4
	Spruce-pine-fir	#2	8-1	10-3	12-7	14-7	7-5	9-5	11-6	13-4
	Spruce-pine-fir	#3	6-2	7-9	9-6	11-0	5-7	7-1	8-8	10-1

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 pound per square foot = 0.0479 kPa.

Note: Check sources for availability of lumber in lengths greater than 20 feet.

a. End bearing length shall be increased to 2 inches.

b. Dead load limits for townhouses in Seismic Design Category C and all structures in Seismic Design Categories D_0, D_1, and D_2 shall be determined in accordance with Section 301.2.2.2.1.

TABLE 502.5(1)
GIRDER SPANS[a] AND HEADER SPANS[a] FOR EXTERIOR BEARING WALLS
(Maximum spans for Douglas fir-larch, hem-fir, southern pine and spruce-pine-fir[b] and required number of jack studs)

GIRDERS AND HEADERS SUPPORTING	SIZE	GROUND SNOW LOAD (psf)[e]																	
		30						50						70					
		Building width[c] (feet)																	
		20		28		36		20		28		36		20		28		36	
		Span	NJ[d]	Span	NJ[d]	Span	NJ[d]	Span	NJ[d]	Span	NJ[d]	Span	NJ[d]	Span	NJ[d]	Span	NJ[d]	Span	NJ[d]
Roof and ceiling	2-2×4	3-6	1	3-2	1	2-10	1	3-2	1	2-9	1	2-6	1	2-10	1	2-6	1	2-3	1
	2-2×6	5-5	1	4-8	1	4-2	1	4-8	1	4-1	1	3-8	2	4-2	1	3-8	2	3-3	2
	2-2×8	6-10	1	5-11	2	5-4	2	5-11	2	5-2	2	4-7	2	5-4	2	4-7	2	4-1	2
	2-2×10	8-5	2	7-3	2	6-6	2	7-3	2	6-3	2	5-7	2	6-6	2	5-7	2	5-0	2
	2-2×12	9-9	2	8-5	2	7-6	2	8-5	2	7-3	2	6-6	2	7-6	2	6-6	2	5-10	3
	3-2×8	8-4	1	7-5	1	6-8	1	7-5	1	6-5	2	5-9	2	6-8	1	5-9	2	5-2	2
	3-2×10	10-6	1	9-1	2	8-2	2	9-1	2	7-10	2	7-0	2	8-2	2	7-0	2	6-4	2
	3-2×12	12-2	2	10-7	2	9-5	2	10-7	2	9-2	2	8-2	2	9-5	2	8-2	2	7-4	2
	4-2×8	9-2	1	8-4	1	7-8	1	8-4	1	7-5	1	6-8	1	7-8	1	6-8	1	5-11	2
	4-2×10	11-8	1	10-6	1	9-5	2	10-6	1	9-1	2	8-2	2	9-5	2	8-2	2	7-3	2
	4-2×12	14-1	1	12-2	2	10-11	2	12-2	2	10-7	2	9-5	2	10-11	2	9-5	2	8-5	2
Roof, ceiling and one center-bearing floor	2-2×4	3-1	1	2-9	1	2-5	1	2-9	1	2-5	1	2-2	1	2-7	1	2-3	1	2-0	1
	2-2×6	4-6	1	4-0	1	3-7	2	4-1	1	3-7	2	3-3	2	3-9	2	3-3	2	2-11	2
	2-2×8	5-9	2	5-0	2	4-6	2	5-2	2	4-6	2	4-1	2	4-9	2	4-2	2	3-9	2
	2-2×10	7-0	2	6-2	2	5-6	2	6-4	2	5-6	2	5-0	2	5-9	2	5-1	2	4-7	3
	2-2×12	8-1	2	7-1	2	6-5	2	7-4	2	6-5	2	5-9	3	6-8	2	5-10	3	5-3	3
	3-2×8	7-2	1	6-3	2	5-8	2	6-5	2	5-8	2	5-1	2	5-11	2	5-2	2	4-8	2
	3-2×10	8-9	2	7-8	2	6-11	2	7-11	2	6-11	2	6-3	2	7-3	2	6-4	2	5-8	2
	3-2×12	10-2	2	8-11	2	8-0	2	9-2	2	8-0	2	7-3	2	8-5	2	7-4	2	6-7	2
	4-2×8	8-1	1	7-3	1	6-7	1	7-5	1	6-6	1	5-11	2	6-10	1	6-0	2	5-5	2
	4-2×10	10-1	1	8-10	2	8-0	2	9-1	2	8-0	2	7-2	2	8-4	2	7-4	2	6-7	2
	4-2×12	11-9	2	10-3	2	9-3	2	10-7	2	9-3	2	8-4	2	9-8	2	8-6	2	7-7	2
Roof, ceiling and one clear span floor	2-2×4	2-8	1	2-4	1	2-1	1	2-7	1	2-3	1	2-0	1	2-5	1	2-1	1	1-10	1
	2-2×6	3-11	1	3-5	2	3-0	2	3-10	2	3-4	2	3-0	2	3-6	2	3-1	2	2-9	2
	2-2×8	5-0	2	4-4	2	3-10	2	4-10	2	4-2	2	3-9	2	4-6	2	3-11	2	3-6	2
	2-2×10	6-1	2	5-3	2	4-8	2	5-11	2	5-1	2	4-7	3	5-6	2	4-9	2	4-3	3
	2-2×12	7-1	2	6-1	3	5-5	3	6-10	2	5-11	3	5-4	3	6-4	2	5-6	3	5-0	3
	3-2×8	6-3	2	5-5	2	4-10	2	6-1	2	5-3	2	4-8	2	5-7	2	4-11	2	4-5	2
	3-2×10	7-7	2	6-7	2	5-11	2	7-5	2	6-5	2	5-9	2	6-10	2	6-0	2	5-4	2
	3-2×12	8-10	2	7-8	2	6-10	2	8-7	2	7-5	2	6-8	2	7-11	2	6-11	2	6-3	2
	4-2×8	7-2	1	6-3	2	5-7	2	7-0	1	6-1	2	5-5	2	6-6	1	5-8	2	5-1	2
	4-2×10	8-9	2	7-7	2	6-10	2	8-7	2	7-5	2	6-7	2	7-11	2	6-11	2	6-2	2
	4-2×12	10-2	2	8-10	2	7-11	2	9-11	2	8-7	2	7-8	2	9-2	2	8-0	2	7-2	2
Roof, ceiling and two center-bearing floors	2-2×4	2-7	1	2-3	1	2-0	1	2-6	1	2-2	1	1-11	1	2-4	1	2-0	1	1-9	1
	2-2×6	3-9	2	3-3	2	2-11	2	3-8	2	3-2	2	2-10	2	3-5	2	3-0	2	2-8	2
	2-2×8	4-9	2	4-2	2	3-9	2	4-7	2	4-0	2	3-8	2	4-4	2	3-9	2	3-5	2
	2-2×10	5-9	2	5-1	2	4-7	3	5-8	2	4-11	2	4-5	3	5-3	2	4-7	3	4-2	3
	2-2×12	6-8	2	5-10	3	5-3	3	6-6	2	5-9	3	5-2	3	6-1	3	5-4	3	4-10	3
	3-2×8	5-11	2	5-2	2	4-8	2	5-9	2	5-1	2	4-7	2	5-5	2	4-9	2	4-3	2
	3-2×10	7-3	2	6-4	2	5-8	2	7-1	2	6-2	2	5-7	2	6-7	2	5-9	2	5-3	2
	3-2×12	8-5	2	7-4	2	6-7	2	8-2	2	7-2	2	6-5	3	7-8	2	6-9	2	6-1	3
	4-2×8	6-10	1	6-0	2	5-5	2	6-8	1	5-10	2	5-3	2	6-3	2	5-6	2	4-11	2
	4-2×10	8-4	2	7-4	2	6-7	2	8-2	2	7-2	2	6-5	2	7-7	2	6-8	2	6-0	2
	4-2×12	9-8	2	8-6	2	7-8	2	9-5	2	8-3	2	7-5	2	8-10	2	7-9	2	7-0	2

(continued)

STAIRWAYS

311.7.4.1 Riser height. The maximum riser height shall be $8^1/_4$ inches (196 mm). The riser shall be measured vertically between leading edges of the adjacent treads. The greatest riser height within any flight of stairs shall not exceed the smallest by more than $^3/_8$ inch (9.5 mm).

311.7.4.2 Tread depth. The minimum tread depth shall be 9 inches (254 mm). The tread depth shall be measured horizontally between the vertical planes of the foremost projection of adjacent treads and at a right angle to the tread's leading edge. The greatest tread depth within any flight of stairs shall not exceed the smallest by more than $^3/_8$ inch (9.5 mm).

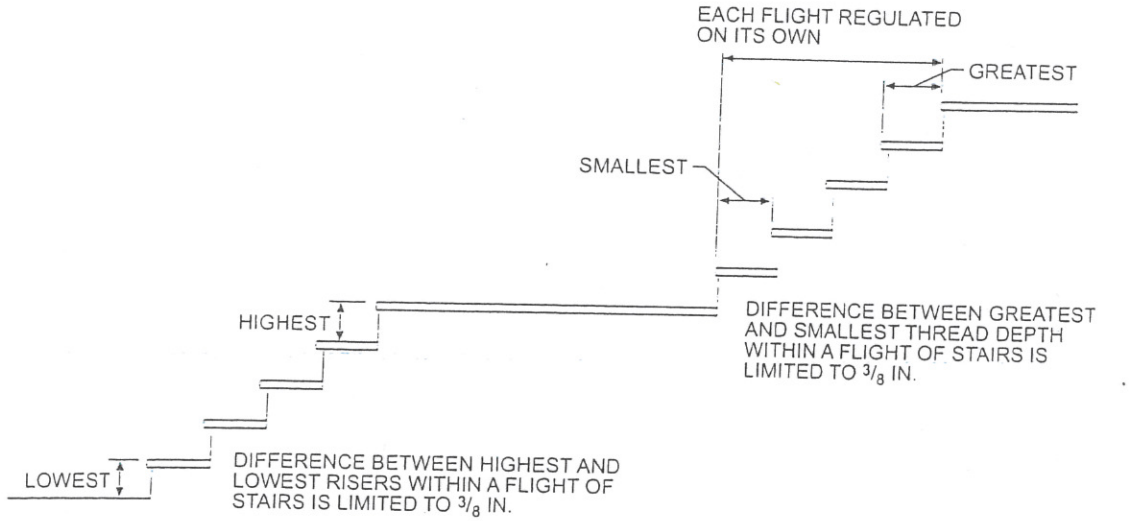

For SI: 1 inch = 25.4 mm.

Figure R311.7.4.1(2)
STAIR TOLERANCES

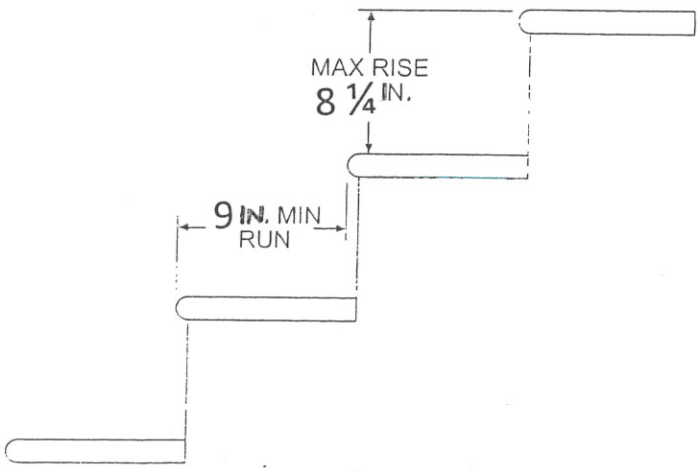

For SI: 1 inch = 25.4 mm.

Figure R311.7.4.1(1)
CONVENTIAL STAIRWAY